

SCIENTIFIC PROOF


Scientific testing has demonstrated the use of ActivePure® Technology to substantially reduce airborne and surface contaminants.

Results based on laboratory testing

OVER 80% REDUCTION IN FLU AND SICK DAYS

>80% Reduction in Flu Related Dismissals

(ActivePure® Technology installed in Indiana School)

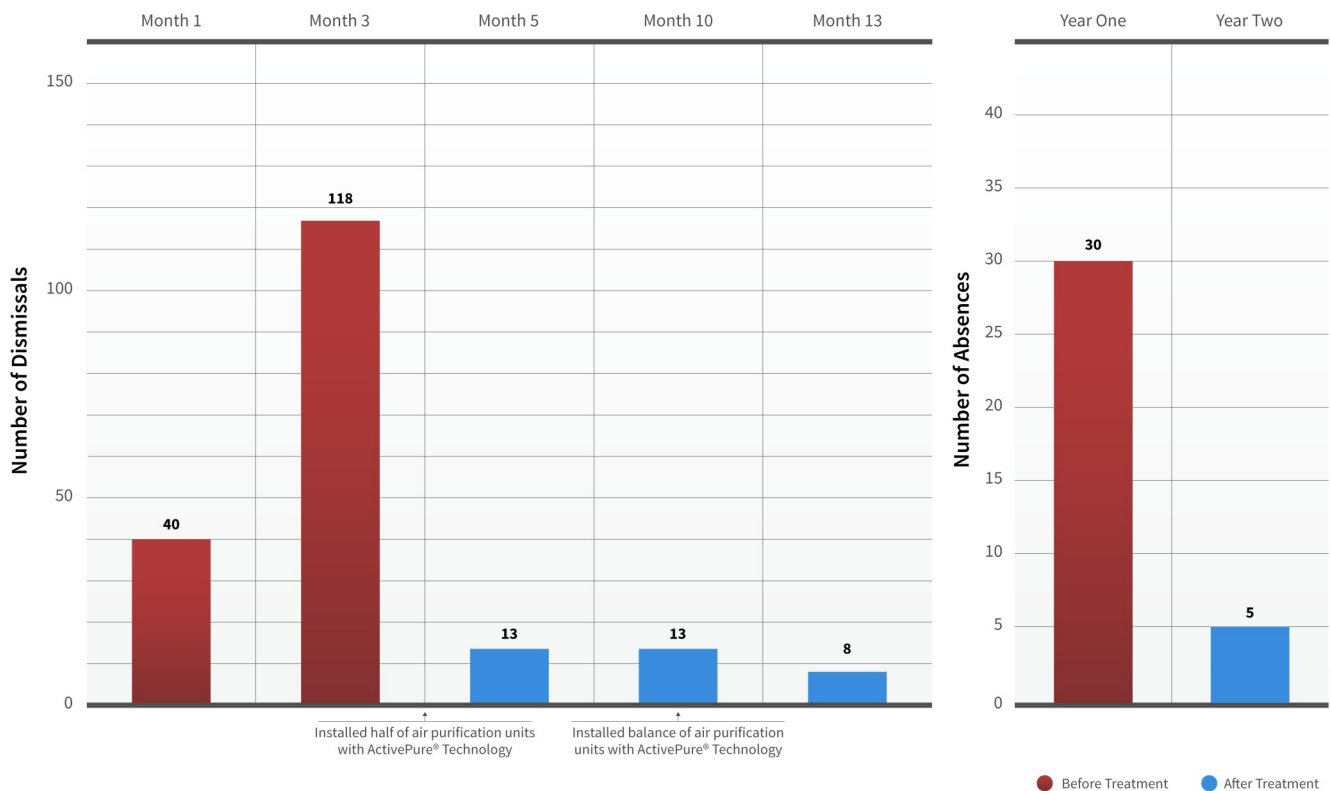

**Air particle tests performed 24 hours after air purifying process was complete*

100% REDUCTION IN VOCs (METHANE GAS ADDITIVE)

(ActivePure® Technology installed in Homes at Porter Ranch)

