


SCIENTIFIC PROOF

Scientific testing has demonstrated the use of ActivePure® Technology to substantially reduce airborne and surface contaminants.

Results based on laboratory testing


RESIDENTIAL – BEFORE AND AFTER Greater Than 99% Elimination

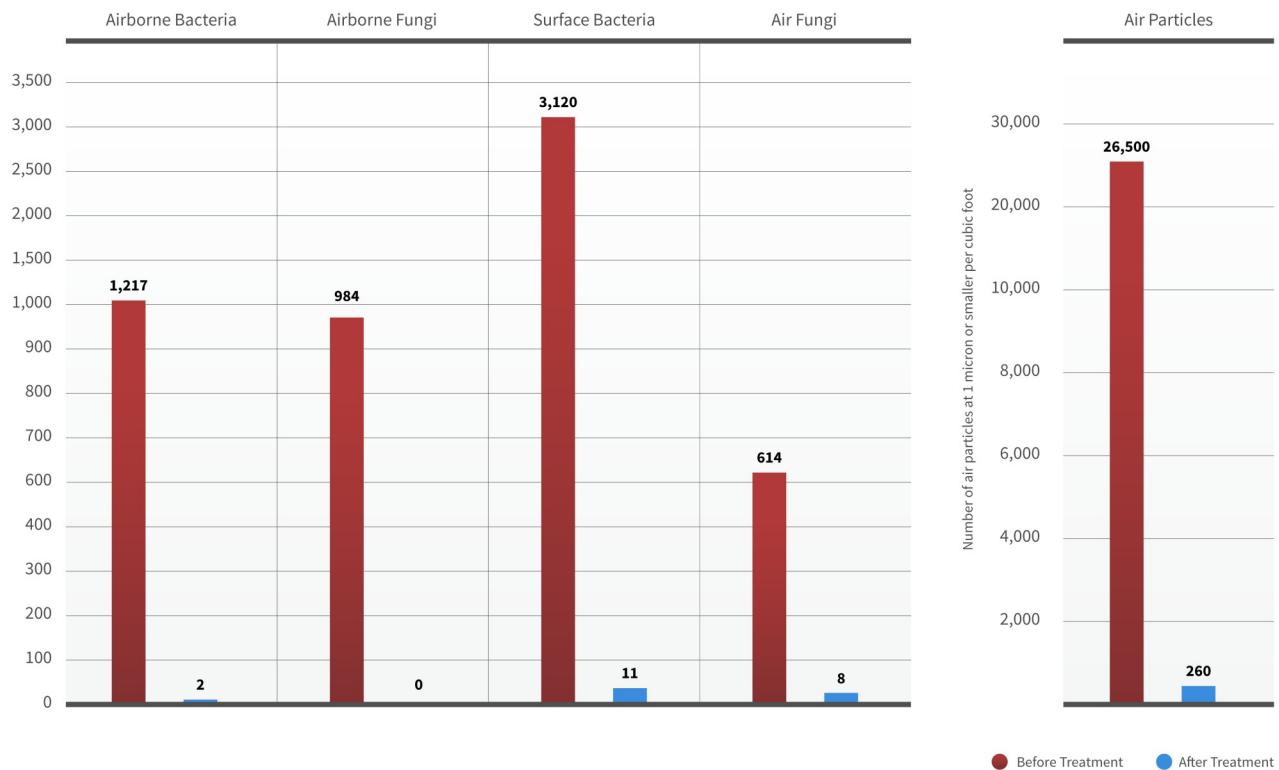


**Air particle tests performed 24 hours after air purifying process was complete*

MEDICAL FACILITIES – BEFORE AND AFTER

Bacteria Test Results: Pediatric Therapy Office

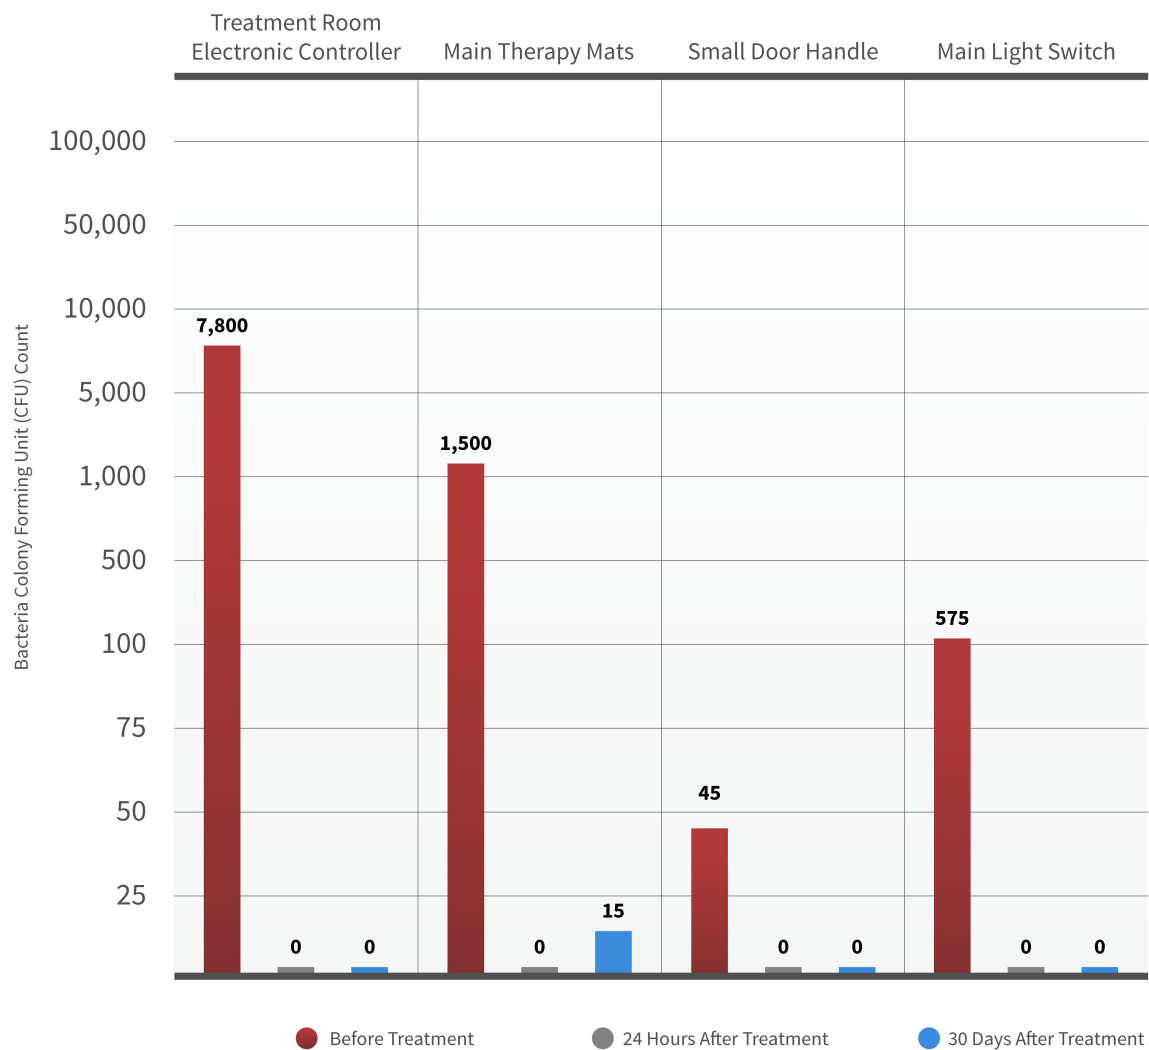

MAJOR LEAGUE BASEBALL – BEFORE AND AFTER
100% Elimination Essentially

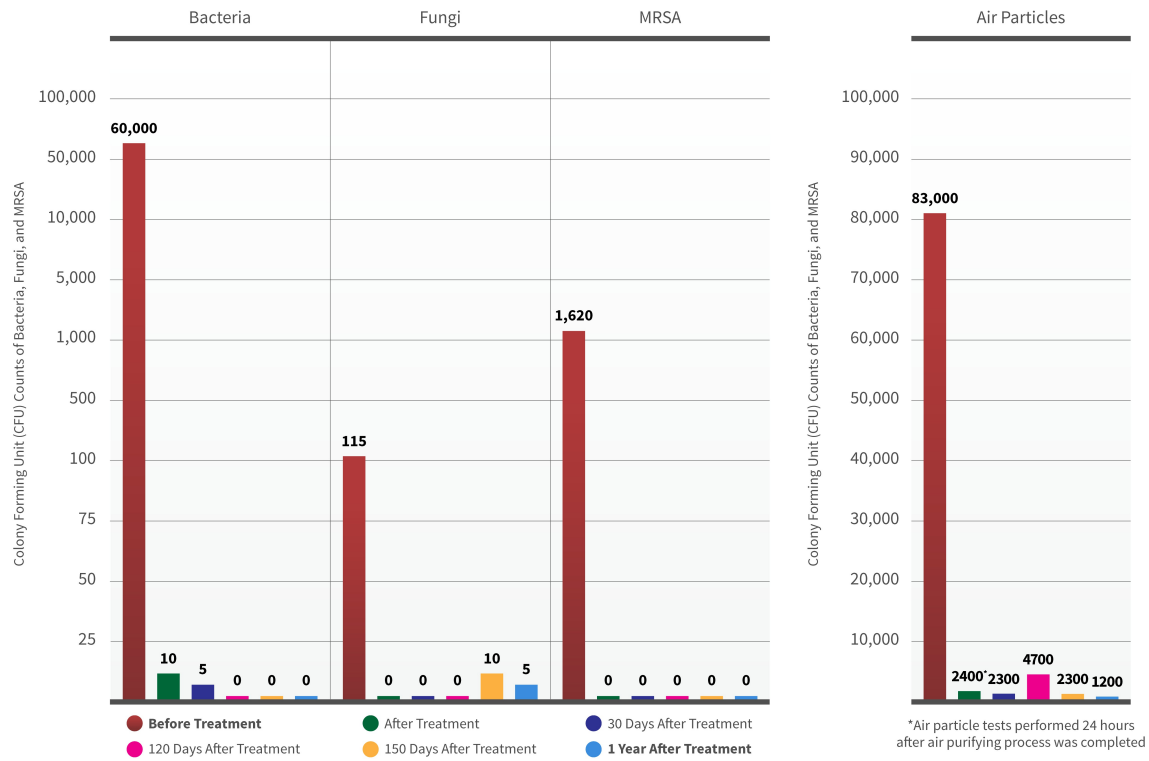

HOSPITAL OPERATING ROOM – BEFORE AND AFTER

